

STATION 10+46

54

STATION 14+27


56

STATION 17+97

57

WALL CONSTRUCTION NOTES


- 1 CONSTRUCT 4" PERFORATED PIPE WRAPPED IN FILTER FABRIC AND 12"x12" GRAVEL AND AT TOP OF FOOTING. DRAIN TO DAYLIGHT AT MINIMUM 1% SLOPE. PERFORATIONS SHALL BE PLACED DOWN AT THE POSITIONS OF 5 AND 7 O'CLOCK.
- 2 OVEREXCAVATE AND RECOMPACT SUBGRADE MINIMUM 2' BEYOND AND BELOW WALL FOUNDATION LIMITS.
- 3 PROVIDE GRANULAR, NON-EXPANSIVE IMPORT BACKFILL AS APPROVED BY PROJECT SOILS ENGINEER. AT 1:1 SLOPE FROM TOP OF FOOTING TO WITHIN MINIMUM 90% RELATIVE COMPACTION. TOP 12" OF FINAL BACKFILL SHALL BE TOPSOIL.

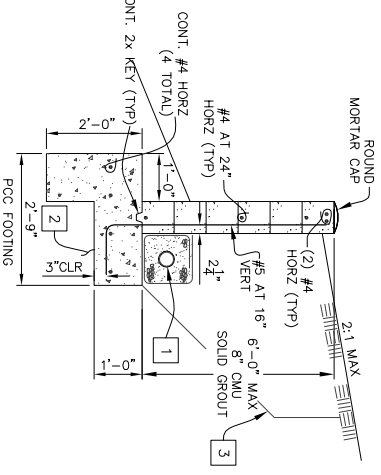

TYPICAL RETAINING WALL

SCALE: 1" = 2'

AG

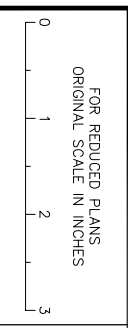

NO.	DATE	REVISIONS	APPD.

DESIGN: CAS CHECKED:

GRAIG A. STEWARD DATE: _____

PROJECT ENGINEER R.C.E. 37,253 (EXP. 06-30-12)

ADOPTED ON AUGUST 23, 2010 BY SANTA MONICA MOUNTAINS CONSERVANCY'S RECREATION AND CONSERVATION AUTHORITY.

CERTIFIED ON _____ BY CALIFORNIA COASTAL COMMISSION.

CROSS SECTION
RAMIREZ CREEK RESTORATION/ENHANCEMENT
SANTA MONICA MOUNTAINS CONSERVANCY
MALIBU, CALIFORNIA

P&S PROJECT NO. 13638.07
SHEET 62 OF 63
PLAN DATE AUGUST 25, 2010